


NOTE:
 SIZE WIDTH OF DE-BONDING TAPE TO PROVIDE UN-ADHERED AREA MINIMUM 5 TIMES LARGER THAN THE MAXIMUM ANTICIPATED EXPANSION. MEMBRANE COVER STRIP MUST EXTEND PAST DE-BONDING TAPE 2" (50 mm) MIN. ALL SIDES.

COSMETIC CRACKS MAY OCCUR IN SURFACING OR FINISH LAYERS APPLIED OVER JOINT. HOLD BACK SURFACING & FINISH 1/4"(6 mm) MIN. FROM BOTH SIDES OF DE-BONDING TAPE WHEN POSSIBLE.

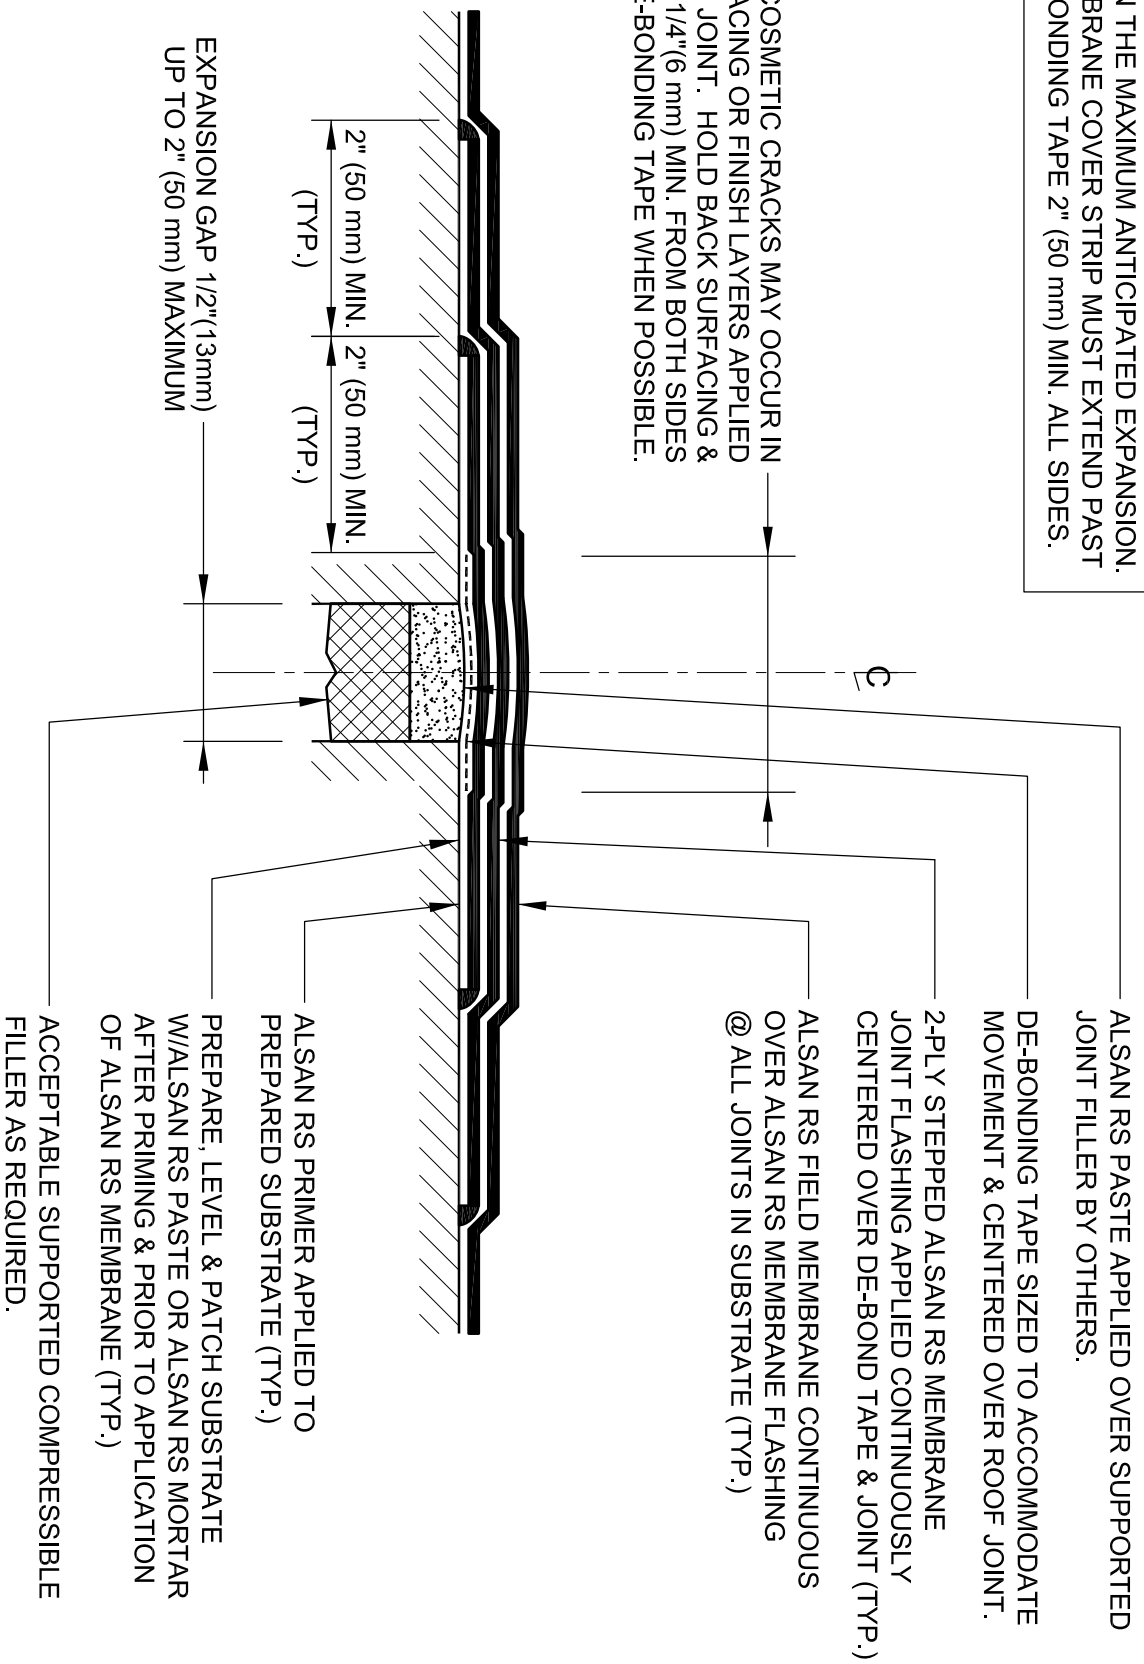

ALSAN RS PASTE APPLIED OVER SUPPORTED JOINT FILLER BY OTHERS.

DE-BONDING TAPE SIZED TO ACCOMMODATE MOVEMENT & CENTERED OVER ROOF JOINT.

2-PLY STEPPED ALSAN RS MEMBRANE JOINT FLASHING APPLIED CONTINUOUSLY CENTERED OVER DE-BOND TAPE & JOINT (TYP.)

ALSAN RS FIELD MEMBRANE CONTINUOUS OVER ALSAN RS MEMBRANE FLASHING @ ALL JOINTS IN SUBSTRATE (TYP.)

ALSAN RS PRIMER APPLIED TO PREPARED SUBSTRATE (TYP.)

PREPARE, LEVEL & PATCH SUBSTRATE W/ALSAN RS PASTE OR ALSAN RS MORTAR AFTER PRIMING & PRIOR TO APPLICATION OF ALSAN RS MEMBRANE (TYP.)

ACCEPTABLE SUPPORTED COMPRESSIBLE FILLER AS REQUIRED.

EXPANSION GAP 1/2"(13mm) UP TO 2" (50 mm) MAXIMUM

2" (50 mm) MIN. (TYP.)

2" (50 mm) MIN. (TYP.)

NOTE: REFER TO SOPREMA RELATED PUBLISHED DOCUMENTATION, PRODUCT DATA SHEETS (PDS) & SAFETY DATA SHEETS (SDS) FOR ADDITIONAL INFORMATION. ALL DETAIL DRAWINGS & RELATED INSTALLATION GUIDELINES ARE PROVIDED BY SOPREMA FOR THE SOLE PURPOSE OF SOPREMA WARRANTY QUALIFICATION. ACCORDINGLY, ANY DETAILS DRAWINGS PROVIDED ARE NOT OFFERED AND SHOULD NOT BE CONSIDERED A SUBSTITUTE FOR PROFESSIONAL DESIGN SERVICES. USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR SOPREMA DETAIL, PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING.

310 QUADRAL DRIVE
 WADSWORTH, OHIO 44281
 (330) 334-0066

**ALSAN RS WATERPROOFING MEMBRANE
 FLUSH EXPANSION JOINT (1/2" to 2" MAX. WIDTH)**

DRAWING NO.:
RS-J2B

REVISION	ISSUE DATE	SCALE	DRAWN BY
0	12-15-2018	N.T.S.	DRW

RS_J02B